
EDEDEDE FURNITURE KEY

| FIRE ST             | RATEGY KEY                        |             |  |
|---------------------|-----------------------------------|-------------|--|
| DH<br>R             | SMOKE DETECTOR HEAT RISE          | FD30S       | FIRE DOOR 30 MINU<br>SELF CLOSE & SMO    |
| DH                  | SMOKE DETECTOR OPTICAL            | SCA         | DOORS FITTED WIT<br>RELEASE DOOR ON      |
| $\bigcirc$          |                                   | РВ          | DOORS FITTED WITH                        |
|                     | SMOKE DETECTOR IONISATION         | VP          | DOOR FITTED WTH                          |
|                     | FIRE ALARM CALL POINT             | N6          | NOTICE TO BOTH SI<br>"FIRE DOOR KEEP S   |
|                     | (BREAK GLASS)                     | N5          | NOTICE "FIRE EXIT H                      |
| $\square$           | FIRE WARNING BELL                 | N3          | NOTICE "KEEP LOCH                        |
| $\bigvee_{w}$       | FIRE EXTINGUISHER WATER 9L        | N2          | NOTICE "STAFF"                           |
| $\overline{\wedge}$ | FIRE EXTINGUISHER DRY POWDER 2.5K | IP          | FIRE ALARM INDICA                        |
| $\wedge$            |                                   | E           | FIRE EXIT LETTERS                        |
|                     | FIRE EXTINGUISHER CARBON DIOXIDE  | $\boxtimes$ | FIRE EXIT SIGN INTE<br>MAINTAINED FITTIN |
| F                   | FIRE EXTINGUISHER FOAM            | $\boxtimes$ | FIRE EXIT SIGN INTE<br>MAINTAINED WITH A |
| B                   | FIRE BLAMKET 1200X1200MM MINIMUM  | $\boxtimes$ | EMERGENCY LIGHT                          |



|   | LEGEND:                    |   |  |  |
|---|----------------------------|---|--|--|
|   | WINDOWS                    |   |  |  |
|   | TOILETS                    | = AS LABELLED                             |  |  |
|   | URINALS                    | = 💿                                       |  |  |
|   | WASH HAND BASINS           | 6 = 🗭                                     |  |  |
|   |                            |   |  |  |
| ES FITTED WITH<br>E SEALS                 | EMERGENCY LIGHTS = 🔶       |   |  |  |
| MAGNETIC DEVICE TO<br>LARM ACTIVATION     | DISTRIBUTION BOAF          | DISTRIBUTION BOARD = WITH ELECTRICS BOARD |  |  |
| PANIC BAR AND<br>SE<br>.AZED VISION PANEL | STEPS                      | =   |  |  |
| ES OF FD30S -<br>UT"                      | SINK UNIT                  | = AS LABELLED                             |  |  |
| EP CLEAR"                                 | MACHINE POINT              | = SWP                                     |  |  |
| D SHUT WHEN NOT IN USE"                   | BAR FLAP                   | = AS LABELLED                             |  |  |
| DR PANEL                                  | ELECTRICS BOARD            | = AS LABELLED                             |  |  |
| R SYMBOL TO                               | TRADE AREAS:               |   |  |  |
| 00MM HIGH MIN.<br>NALLY ILLUMINATED       | SEATING IS INDICATIVE ONLY |   |  |  |
| NALLY ILLUMINATED<br>DIRECTIONAL ARROW    |                            |   |  |  |
|   |                            |   |  |  |

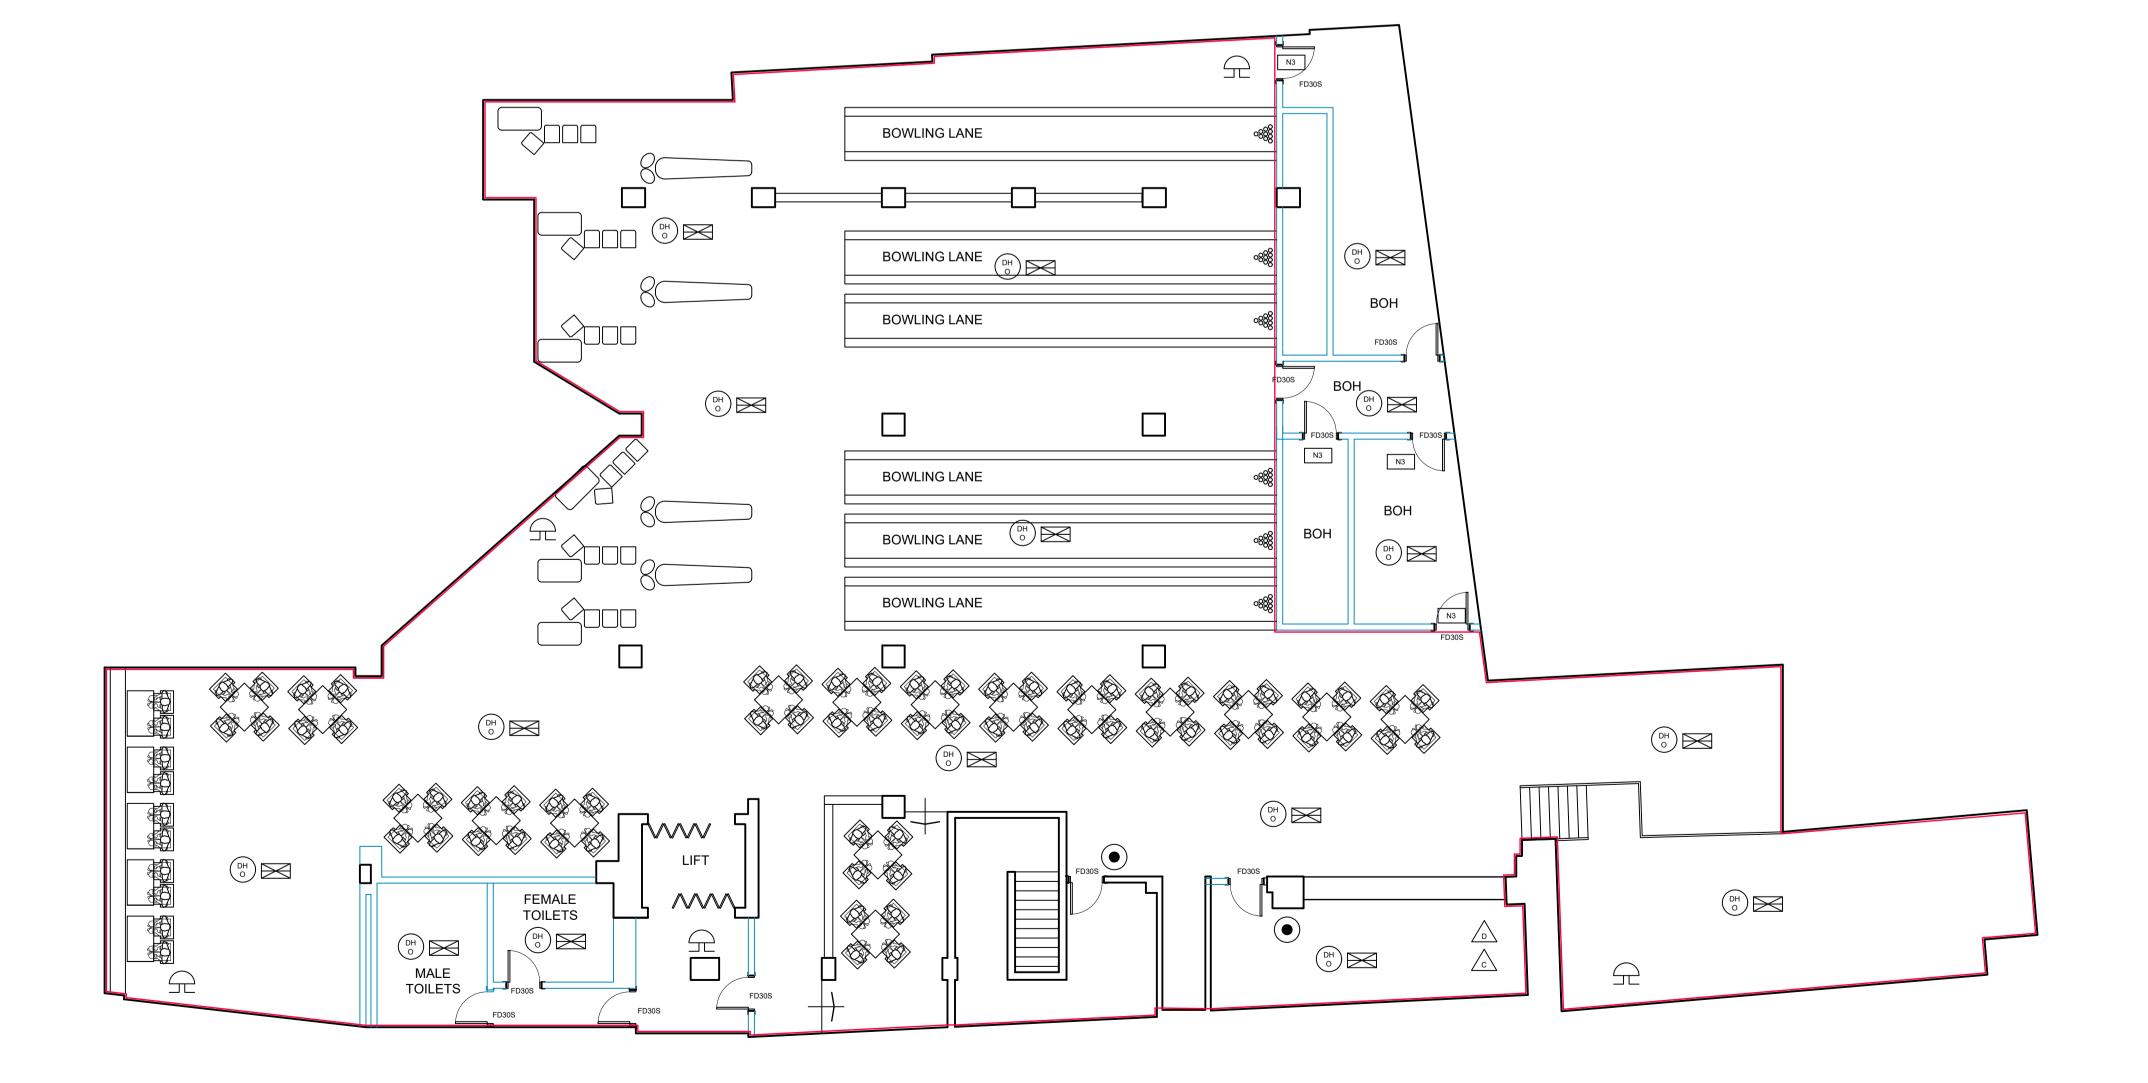